

BURNER REFERENCE LIST

STEAM BOILERS

COMBUSTION CONCEPTS PVT LTD

Steam Boiler 10TPH, Fuel: NG /FO
Type: ECR (LAMTEC-ETAMATIC) Site: Hindustan Coca Cola, Siliguri



Steam Boiler 30TPH, Twin Furnace

Fuel: NG

Type: ECR (LAMTEC-ETAMATIC) with Online O₂ trimming


Site: GACL, BARODA-GUJRAT



Application: Steam Boiler 4TPH
Burner type: ECR (LAMTEC-BT)
Fuel: LPG
Site: Globe Groups, Bangladesh




Application: Steam Boiler 20 TPH, Twin Furnace
Fuel: FO & NG
Site: CEAT Tyres, Halol, Baroda

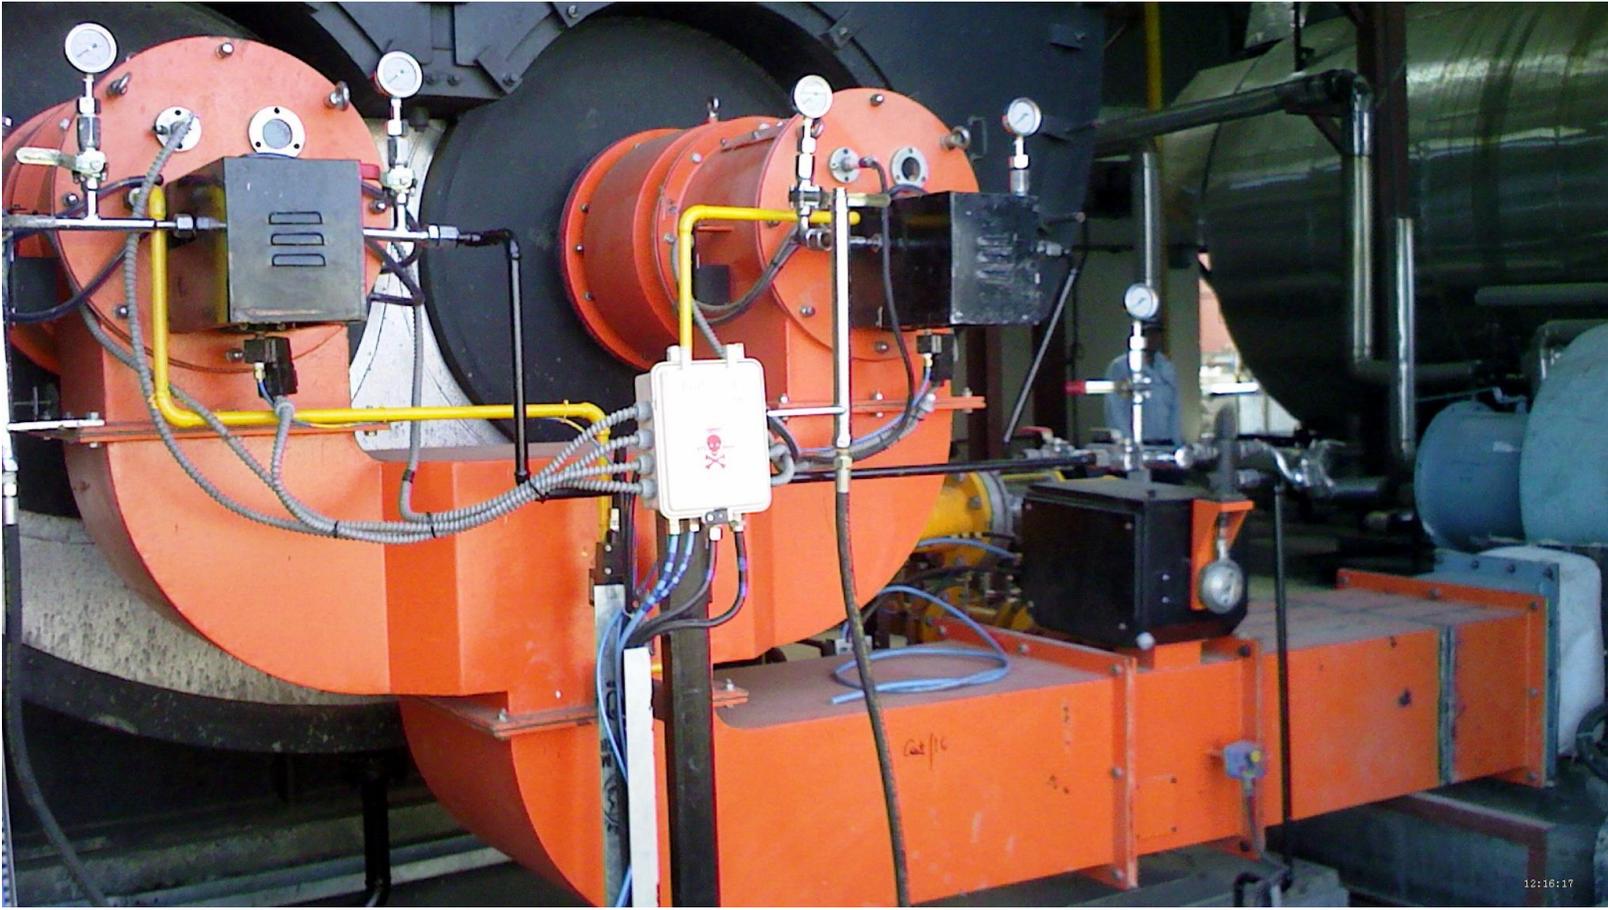

12:16:17

Application: Steam Boiler 10 TPH
Fuel: FO & NG
Type: ECR (LAMTEC-BT) with online O₂ analyzers
Site: UNIWAX, Abidjan, IVORY COAST

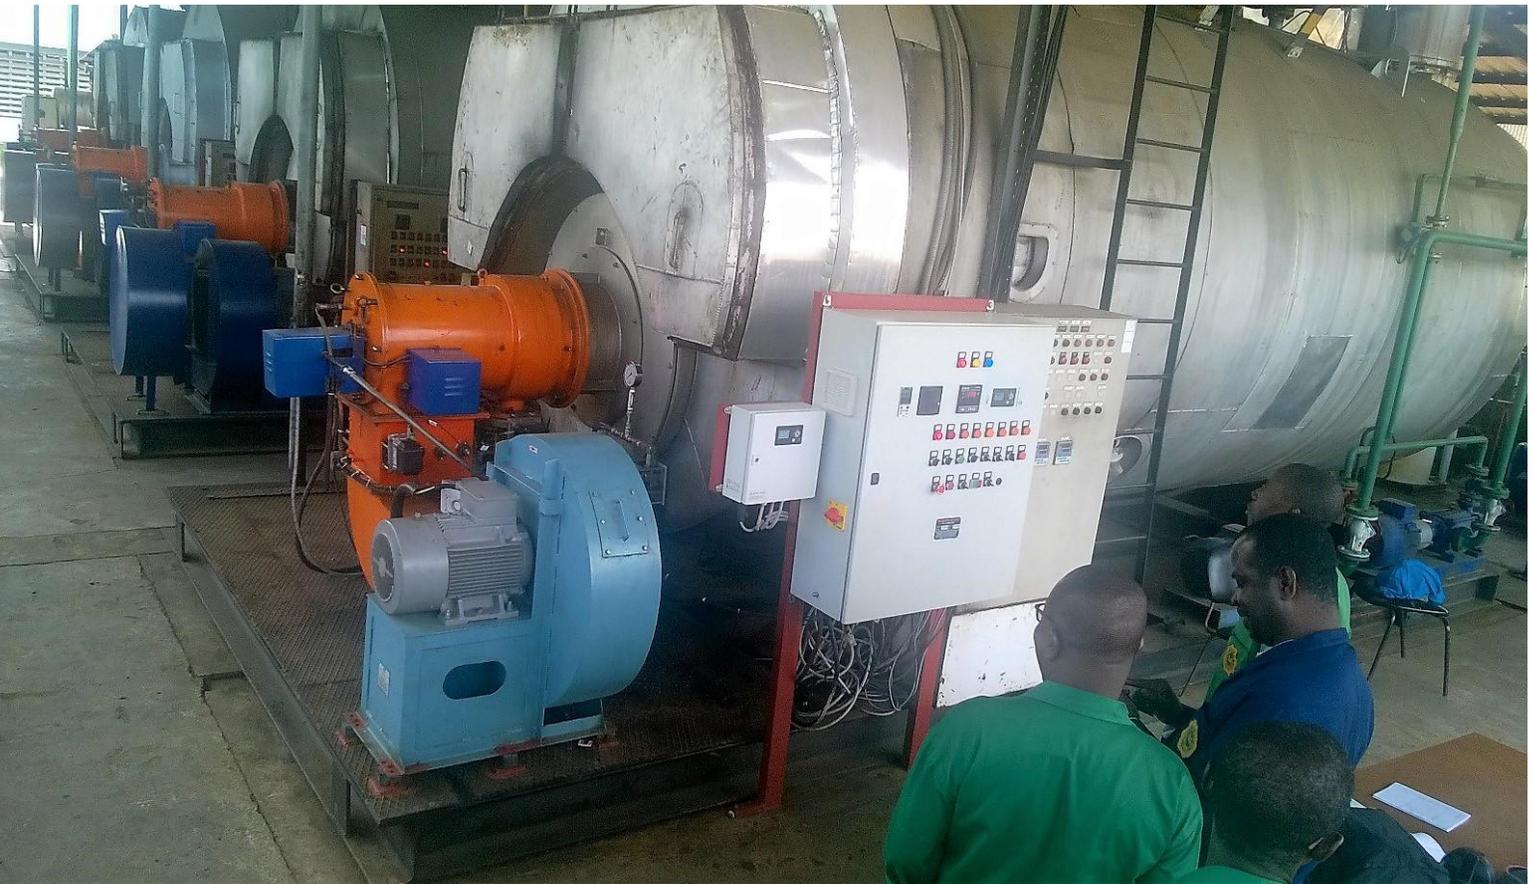

Application: Steam Boiler 12 TPH (HEATEX)

Fuel: NG / FO

Burner type: ECR (LAMTEC-ETAMATIC)

Site: Amines Ltd, Turbhe, New-Mumbai



Application: Steam Boiler 8 TPH
Fuel: NG / BIO-GAS (100% FO, 100% BG & Mixed firing)
Site: Jakaraya Sugars, Solapur



Application: Steam Boiler 8 TPH (IBL)

Fuel: NG / FO

Site: Vertellus S M, P Vapi



Application: Steam Boiler 13 TPH

Fuel: FO

Site: CEAT TYRES, NAGPUR



Application: Steam Boiler 10 TPH
Fuel: NG & FO
Site: SEAPRIDE LLC, OMAN



Application: Steam Boiler 10 TPH (RAKHOH)

Fuel: FO

Site: SREENATH MASKOBA, DAUND-PUNE



Application: Steam Boiler 10 TPH
Fuel: LDO/NG
Site: CG FOODS BANGLADESH LTD



Application: Steam Boiler 20 TPH TWIN FURNACE
Fuel: FO/NG ECR (AUTOFLAME) BURNER
Site: CEAT HALOL




Application: Steam Boiler 3 TPH (CHEEMA BOILERS)
Fuel: FO, ECR (LAMTEC-BT) BURNER
Site: SERENE HEALTHCARE, TASHKENT, USBESKISTAN



Application: Steam Boiler 13 TPH (ASHWINI ENGINEERS)

Fuel: FO & BIOGAS

Site: BANNARI AMMAN SUGAR, ERODE

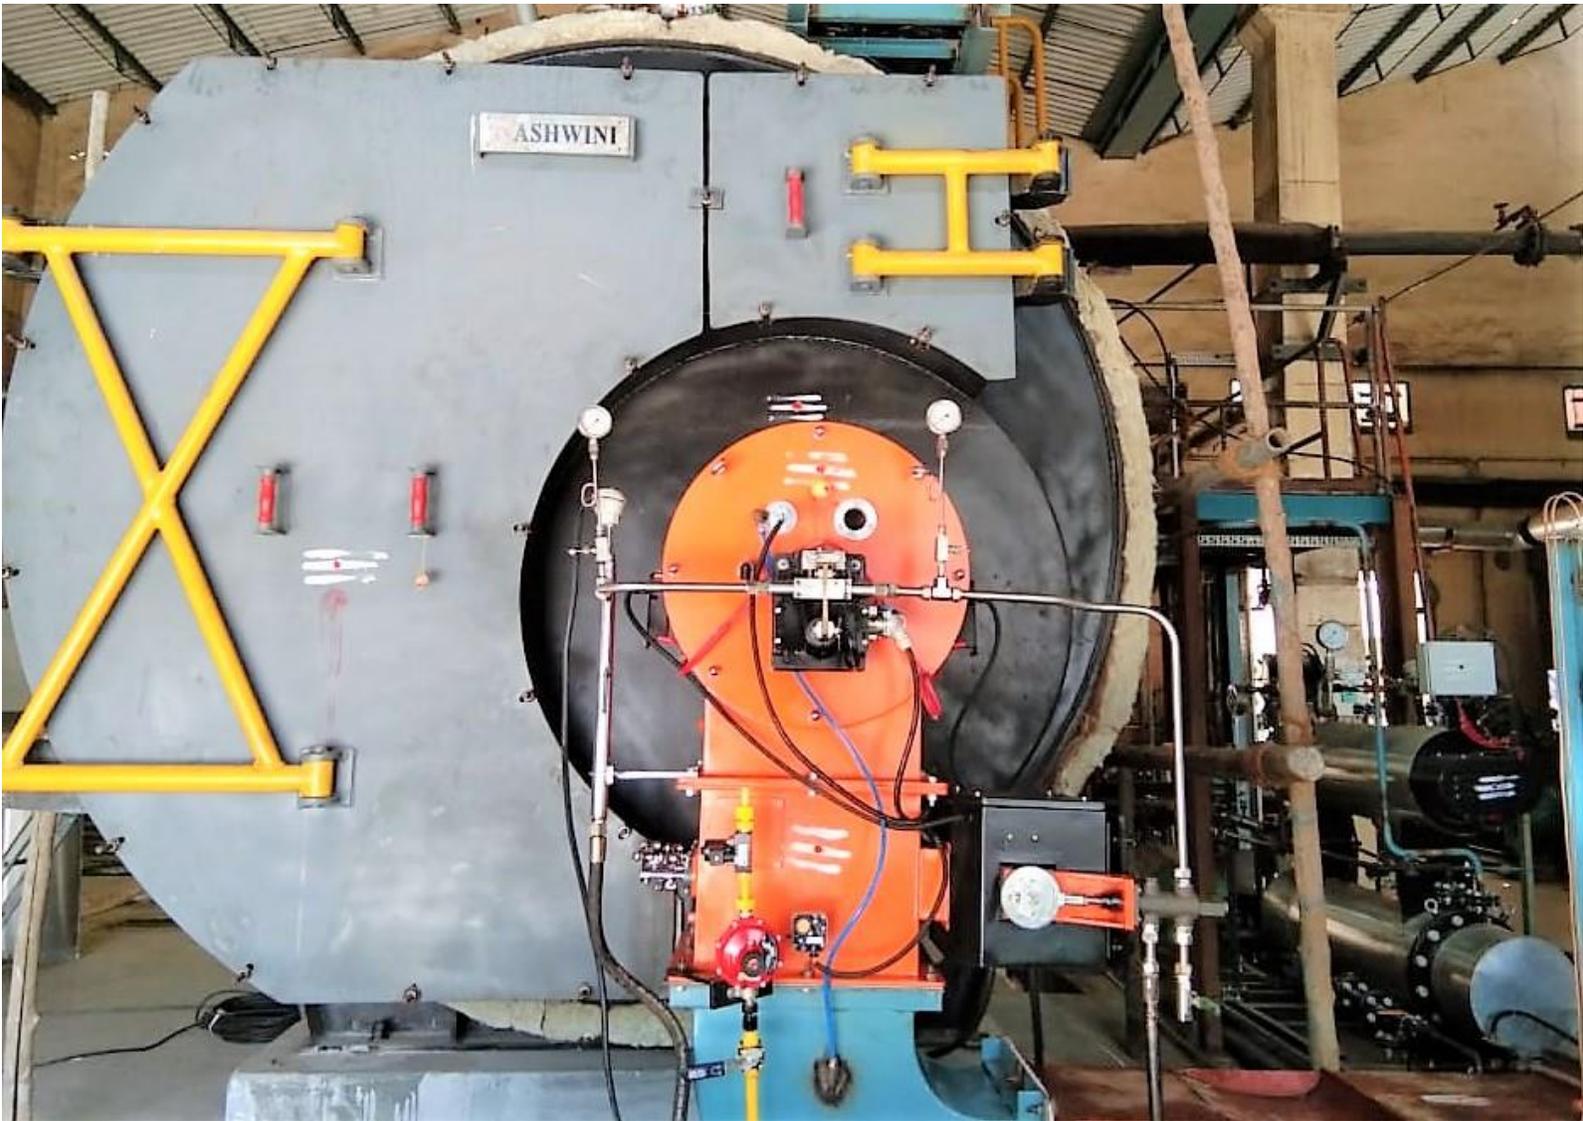

Application: Steam Boiler 13 TPH (ISGEC)

Fuel: FO

Site: MIDHANI, HYDERABAD



Application: Steam Boiler 25 TPH (ISGEC) TWIN FURNACE
Fuel: BF GAS/NG ECR (LAMTEC-ETAMATIC) BURNER
Site: JSW, DOLVI-PEN



Application: Steam Boiler 8TPH (IBL) – **HOT AIR DESIGN**

Fuel: FO/NG

Site: Yashwashi Fish Meal & Oil, Mangalore



Application: Steam Boiler 10 TPH (FORBES MARSHALL)
Fuel: FO/NG, ECR (AUTOFLAME) BURNER
Site: AHLCON INDIA, BHIWADI-RAJASTHAN



Application: Steam Boiler 16 TPH (MAGO THERMAL) – 2 NOS
Fuel: NG, ECR (AUTOFLAME) BURNER
Site: GOODYEAR TYRE (DELHI)



Application: Steam Boiler 8 TPH (IBL)
Fuel: NG
Site: E-POLYMERS, NOIDA – DELHI



Application: Steam Boiler 12 TPH (ASHWINI ENGINEERS)

Fuel: FO

Site: VEERAL ADDITIVES MAHAD



Application: Steam Boiler 6.3 TPH & 3.5 TPH (FMPL)

Fuel: FO

SITE: INDIAN IMMUNOLOGICALS LIMITED



Application: Steam Boiler 8 TPH (FMPL)
Fuel: FO/NG, ECR (AUTOFLAME) BURNER
Site: ELITE PAPER (QATAR)



Application: Steam Boiler 10 TPH (FMPL)
Fuel: FO/NG, ECR (AUTOFLAME) BURNER
Site: BHARAT BIOTECH (TELENGANA)



Application: Steam Boiler 10 TPH (FORBES MARSHALL)
Fuel: FO/NG, ECR (AUTOFLAME) BURNER
Site: METRO DAIRY, KOLKATA



Application: Steam Boiler 15 TPH (FMPL)
Fuel: FO/NG, ECR (AUTOFLAME) BURNER
Site: ELITE PAPER (QATAR)



Application: Steam Boiler 25 TPH, Twin Furnace
Fuel: NG, ECR (AUTOFLAME) BURNER
Site: POSCO, MAHARASHTRA



Application: Steam Boiler 8 TPH,
Fuel: BF Gas & FO, ECR (AUTOFLAME) BURNER
Site: TATA METALIKS, KHARAGPUR

